System Architecture Overview

This page defines the **AOFS system architecture**, including all layers, their responsibilities, interactions, and data flows. It establishes **authority boundaries**, **offline operation rules**, and **federation/synchronization requirements** for AOFS controllers.

All AOFS-compliant systems **must conform** to the rules specified here.

1. Architecture Layers


AOFS defines three core layers:

- Field Controller Layer
- Farm Controller Layer (Local / Federated)
- HQ / Federated Controller Layer

All controller layers **expose a human interface appropriate to their authority and audience**, while **never bypassing Field Controller safety rules**.

—

2. Authority & Data Flow Diagram

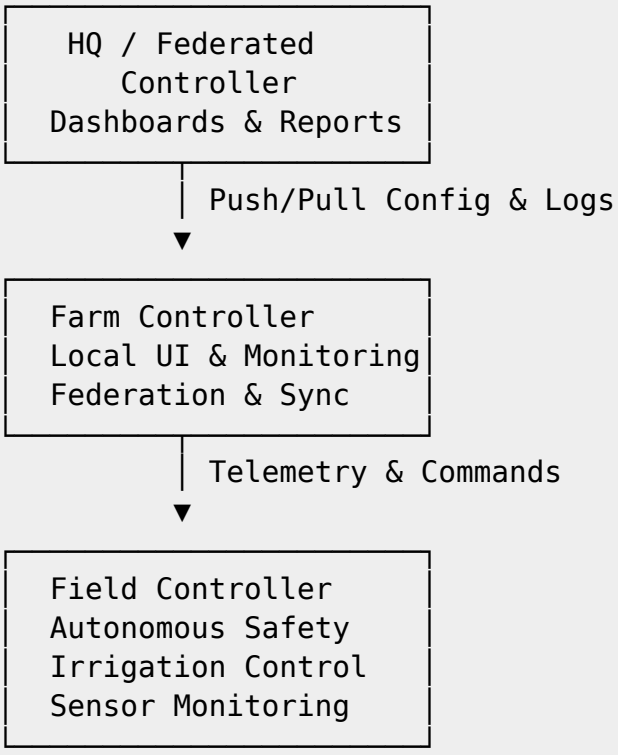

Legend:

- **Field Controller:** authoritative for safety-critical irrigation.
- **Farm Controller:** local supervision, configuration, and federation; respects Field Controller authority.
- **HQ Controller:** multi-farm oversight, reporting, analytics; may propose updates but cannot override Field Controller safety logic.

—

3. Controller Responsibilities

Layer	Primary Role	Human Interface	Connectivity	Authority
——-	———-	————	———-	——-
Field Controller	Execute irrigation & safety	Embedded UI for monitoring / non-critical overrides	None (offline)	Authoritative locally
Farm Controller	Local supervision & federation	Full UI: monitoring, configuration	Optional (for federation)	Supervisory (non-critical only)
HQ Controller	Multi-farm oversight & analytics	Dashboards, reporting, config proposals	Required for federation	Supervisory (proposals only)

—

4. Federation / Sync Model

- **Push/Pull:** Farm Controllers sync with HQ and/or peer farms.
- **Conflict Resolution:**
  - Timestamp precedence
  - Operator approval for schedule/config conflicts
  - Field Controller safety rules **always take priority**
- **Offline First:**
  - Controllers continue autonomous operation if disconnected
  - Logs and changes queue for synchronization once connectivity is restored

—

5. Human Interface Rules

- All controllers expose interfaces appropriate to their role:
  - Field Controller: embedded status UI, safety alerts, non-critical operator overrides
  - Farm Controller: full local UI for monitoring, configuration, and federation
  - HQ Controller: multi-farm dashboards, analytics, authorized configuration proposals
- No interface may bypass Field Controller safety rules.

—

6. Communication Model & Protocol Independence

- Controller layers may communicate using one or more standardized protocols (see Communication Protocols & Standards)
- Protocol choice does not define authority
- Communication transport is strictly separated from control authority

- Field Controller authority is defined by architectural rules, not by message origin
- Remote commands received via MQTT, AMQP, or other protocols must always be validated locally
- Loss of connectivity must never affect safety-critical irrigation execution
- Communication failure must default to safe autonomous operation

- AOFS architecture is protocol-agnostic
- Multiple protocols may coexist within a deployment
- Implementations must ensure auditability of all received and transmitted messages

—

7. Compliance Notes

- AOFS-compliant deployments **must implement all three layers** as defined.
- Field Controller safety rules **cannot be overridden** by higher layers.
- All push/pull, configuration changes, and operator actions **must be logged**.
- Offline operation **must not compromise irrigation or safety**.
- Failure to respect authority boundaries **invalidates AOFS compliance**.

—

8. References

- Field Controller Layer
- Farm Controller Layer (Local / Federated)
- HQ / Federated Controller Layer
- Hydraulic & Water Systems
- Electrical & Control Interfaces
- Measuring, Monitoring & Documentation Systems

From:
http://wiki.irrigation.afriticgroup.com/ - **Afritic Open Farming Standard**

Permanent link:
http://wiki.irrigation.afriticgroup.com/doku.php?id=architecture:start&rev=1771809052

Last update: **2026/02/23 01:10**